

Model: PX600

TWO 300 WATT TRANSFORMERS IN ONE ENCLOSURE

RATING, EACH TRANSFORMER:

INPUT: 120V 60 Hz. 3 Amp. Max

OUTPUT: 12V, 13V, or 14V AC 300 Lamp -Watts Max Any Tap

IMPORTANT SAFETY INSTRUCTIONS

When installing and operating this Product and other associated equipment, basic safety precautions should always be followed, including the following:

1. Read and follow all instructions.
2. Do not submerge transformer.
3. Do not connect two or more transformers in parallel.
4. This transformer must be installed by a qualified electrician, according to the National Electrical Codes.
5. Install this transformer not less than 5 feet from inside edge of pool. USE COPPER CONDUCTORS ONLY.
6. Do not exceed the maximum ratings of individual components, wiring devices, and current carrying capacity of conductors.
7. For grounding and bonding this transformer and the installation, refer to section 680 of the National Electrical Code.

READ, FOLLOW AND SAVE THIS INSTRUCTION MANUAL

GENERAL INFORMATION

This Safety Transformer is specifically designed to supply 12 volts to pool/spa lights, submersible fixtures and outdoor garden lights. A grounded shield between the primary and secondary winding assures safe operation and the built-in circuit protection will disconnect power to the transformer in case of defect or overload.

SPECIFICATIONS

Enclosure Size: 10" (25.5 cm) high x 10" (25.5 cm) wide x 5 1/4" (13 cm) deep. Mounting brackets top and bottom.

Enclosure: 0.048" corrosion resistant steel with electrostatically applied beige coating.

Knockouts: Total of twelve combination, (4) 3/4-1, (2) 1/2-3/4 bottom, 1/2-3/4 (2) right side, (2) left side, (2) back.




INSTALLATION

For field wiring information, please refer to the instructions attached to inside of front cover.

- The enclosure of the transformer must be provided with a fail-proof ground as required by NEC, Article 680 and any applicable local codes. For Canadian installations, the supply circuit must be protected by a ground fault circuit interrupter.
- For direct wiring of underwater lights, the installation must comply with article 680-21(b) of the National Electrical Code, or articles 68-060, 062 and 066 of the Canadian Electric Code.
- The transformer should be mounted at least 1 foot above the deck level with the field wiring compartment down.
- Make sure that all unused taps (leads) are **separately** insulated (capped).
- Use the following table as a guide to determine the correct wire size.
- Check voltage at lamp terminals after installation. It should be 12 ± 0.3 volts.
- **Do not connect the two transformers in parallel or in series, Do not use with dimmers.**

TYPICAL WIRING

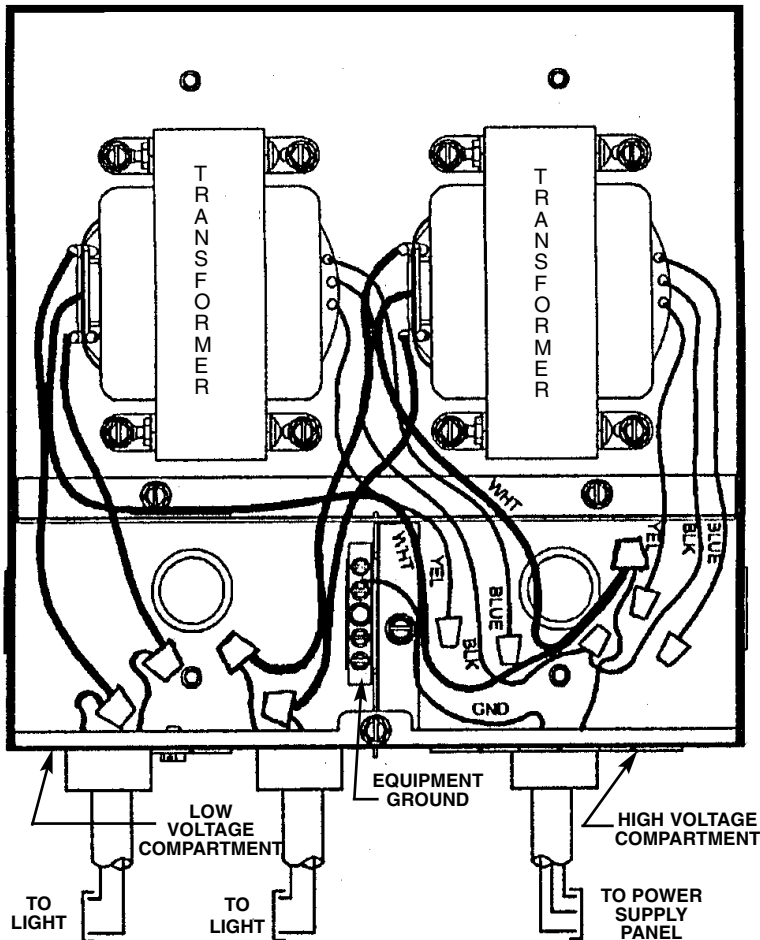

WIRING INSTRUCTIONS

1. Use copper conductors only. Connect grounding conductor to equipment ground. High and low voltage compartments may be interchanged, but must be separated from each other.
2. Connect WHITE lead from Transformer, to NEUTRAL (white) of Power Supply.
3. Connect BLACK (12 V) or YELLOW (13 V) or BLUE (14V) lead from Transformer to 120 VAC, 60 Hz. supply (Line).

Secondary Output

Connections
 12 VOLT Black To Supply
 13 VOLT Yellow To Supply
 14 VOLT Blue To Supply

Make sure unused leads are insulated (CAPPED).

4. Connect conductors from light to Transformer leads in Low Voltage compartment.

120 Volt Primary Input - 300 Watt Output

Distance* Feet	2#6AWG	2#8AWG	2#10AWG	2#12AWG
5 Ft.	12V	12V	12V	12V
10 Ft.	12V	12V	12V	13V
20 Ft.	12V	12V	13V	13V
30 Ft.	12V	13V	13V	14V
40 Ft.	13V	13V	14V	
50 Ft.	13V	13V	14V	
60 Ft.	13V	14V		
70 Ft.	13V	14V		
80 Ft.	13V	14V		
90 Ft.	14V			
100 Ft.	14V			
110 Ft.	14V			

* Length of run to light from transformer.

LANDSCAPE LIGHTING APPLICATIONS

For field wiring information, please refer to the instructions attached to inside of front cover.

Using the correct gauge cable and wattage is essential to obtaining proper lighting performance. The low voltage cable for each run must not exceed 100 Ft. and must have a current carrying capacity of at least 20 amp (12 gauge). Determine the total lamp wattage by adding together all the individual lamp wattage's being used. Do not exceed the maximum wattage rating for the transformer

WARRANTY

If, within the warranty period specified, this product fails due to a defect in material or workmanship, Intermatic Incorporated will repair or replace it, at its sole option, free of charge. This warranty is extended to the original household purchaser only and is not transferable. This warranty does not apply to: (a) damage to units caused by accident, dropping or abuse in handling, acts of God or any negligent use; (b) units which have been subject to unauthorized repair, opened, taken apart or otherwise modified; (c) units not used in accordance with instructions; (d) damages exceeding the cost of the product; (e) sealed lamps and/or lamp bulbs, LED's and batteries; (f) the finish on any portion of the product, such as surface and/or weathering, as this is considered normal wear and tear, (g) transit damage, initial installation costs, removal costs, or reinstallation costs.

INTERMATIC INCORPORATED WILL NOT BE LIABLE FOR INCIDENTAL OR CONSEQUENTIAL DAMAGES. SOME STATES DO NOT ALLOW THE EXCLUSION OR LIMITATION OF INCIDENTAL OR CONSEQUENTIAL DAMAGES. SO THE ABOVE LIMITATION OR EXCLUSION MAY NOT APPLY TO YOU. THIS WARRANTY IS IN LIEU OF ALL OTHER EXPRESS OR IMPLIED WARRANTIES. ALL IMPLIED WARRANTIES, INCLUDING THE WARRANTY OF MERCHANTABILITY AND THE WARRANTY OF FITNESS FOR A PARTICULAR PURPOSE, ARE HEREBY MODIFIED TO EXIST ONLY AS CONTAINED IN THIS LIMITED WARRANTY, AND SHALL BE OF THE SAME DURATION AS THE WARRANTY PERIOD STATED ABOVE. SOME STATES DO NOT ALLOW LIMITATIONS ON THE DURATION OF AN IMPLIED WARRANTY, SO THE ABOVE LIMITATION MAY NOT APPLY TO YOU.

This warranty gives you specific legal rights and you may also have other rights which vary from state to state. Warranty service is available by mailing postage prepaid to: Intermatic Incorporated/After Sales Service, 7777 Winn Rd., Spring Grove, IL 60081-9698/815-675-7000 <http://www.intermatic.com>. Please be sure to wrap the product securely to avoid shipping damage.

Because of our commitment to continuing research and improvements, Intermatic Incorporated reserves the right to make changes, without notice, in the specifications and material contained herein and shall not be responsible for any damages, direct or consequential, caused by reliance on the material presented.

INTERMATIC INCORPORATED, SPRING GROVE, IL 60081-9698

<http://www.intermatic.com>